


MINIMUM 18' TREATED POLE LESS THAN 5 YEARS OLD, AND IN SOUND CONDITION

*NOTES:

- (1) INSTALL METER BASE
9 1/2' FROM BOTTOM OF POLE TO
OBTAIN METER CLEARANCE OF 4' TO 6'
FROM FINAL GRADE WHEN POLE IS SET.
- (2) IF BACKBOARD IS USED, USE MINIMUM
3/4" TREATED BOARD.
- (3) 100 AMP POWER PANEL MAY BE USED
- (4) POLE LOCATION MUST BE 5' FROM ANY
BUILDING, TRAILER, WALL, SHED OR SIDING
NATIONAL ELECTRICAL SAFETY CODE
230 C2; TABLE 234-1.
- (5) ALWAYS CALL 811 BEFORE DIGGING
- (6) CONTACT YOUR COUNTY BUILDING DEPARTMENT
FOR LOCAL BUILDING CODES
- (7) BEFORE SETTING POLE, PLEASE CONTACT
CHELCO TO SPOT THE LOCATION OF THE
POLE @ 892-2111 OR 1-800-342-0990
(ENGINEERING DEPARTMENT)

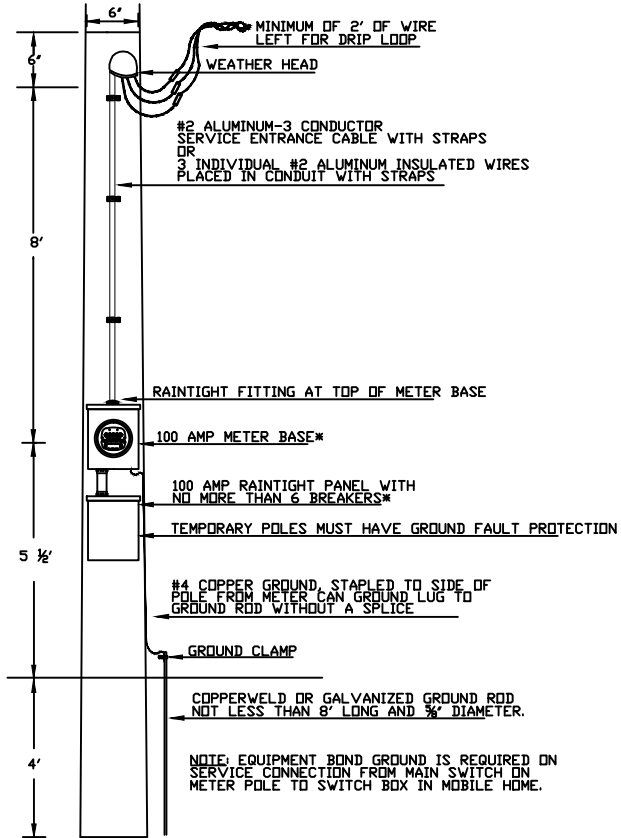

100 AMP METER POLE

DEC. 2013

CHELCO