


MINIMUM 18' TREATED POLE LESS THAN 5 YEARS OLD, AND IN SOUND CONDITION

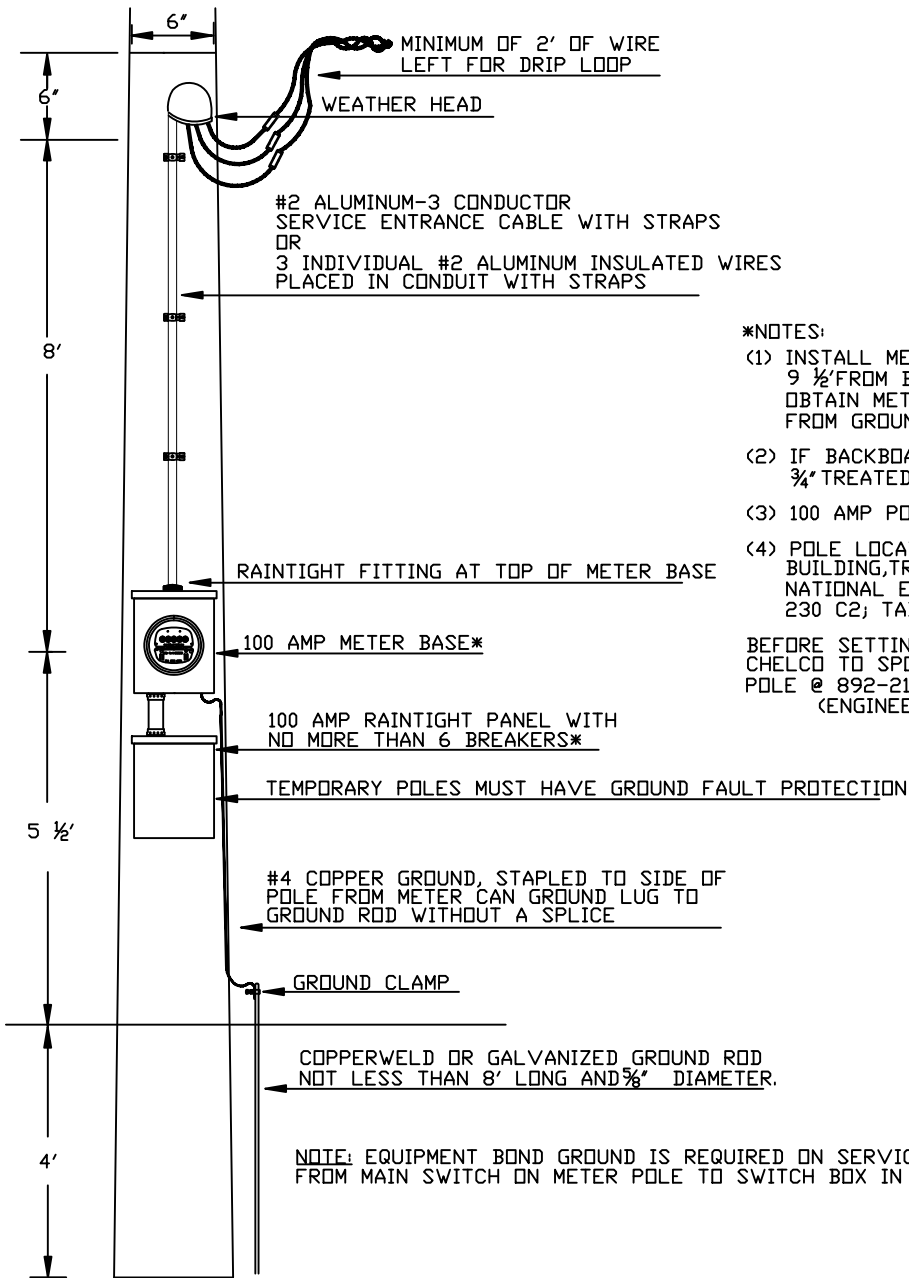

\*NOTES:

- (1) INSTALL METER BASE 9 1/2' FROM BOTTOM OF POLE TO OBTAIN METER CLEARANCE OF 5 1/2' FROM GROUND WHEN POLE IS SET.
- (2) IF BACKBOARD IS USED, USE MINIMUM 3/4" TREATED BOARD.
- (3) 100 AMP POWER PANEL MAY BE USED
- (4) POLE LOCATION MUST BE 5' FROM ANY BUILDING, TRAILER, WALL, SHED, OR SIDING. NATIONAL ELECTRICAL SAFETY CODE 230 C2; TABLE 234-1.

BEFORE SETTING POLE, PLEASE CONTACT CHELCO TO SPOT THE LOCATION OF THE POLE @ 892-2111 OR 1-800-342-0990. (ENGINEERING DEPARTMENT)

## 100 AMP METER POLE INSTALLATION

DEC. 2008

CHELCO