


NOTES:

- (1) 200 AMP METER BASE AND PANEL (TO BE RAIN TIGHT) OR 200 AMP POWER PANEL CAN BE USED.
- (2) IF S.E. CABLE IS USED INSTEAD OF MAST, CUSTOMER MUST GET SPECIFICATION FROM E.M.C.
- (3) ALWAYS CALL 811 BEFORE DIGGING
- (4) CONTACT YOUR COUNTY BUILDING DEPARTMENT FOR LOCAL BUILDING CODES

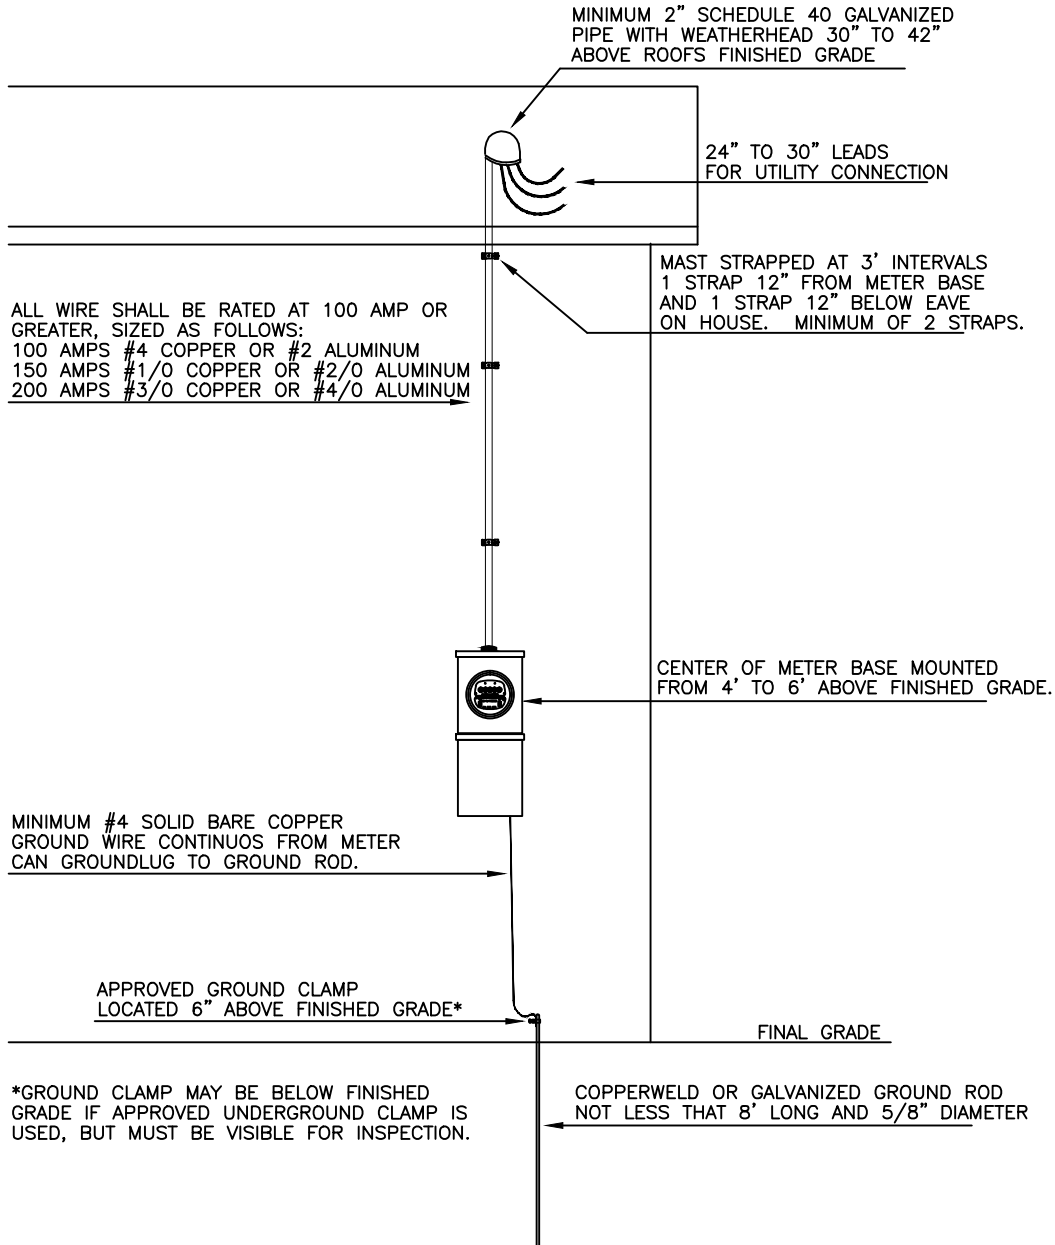

SPECIFICATIONS FOR SINGLE PHASE SERVICE ENTRANCE

DEC. 2013

CHELCO